


1. ALL SMOKE DETECTORS MUST BE INTERCONNECTED.
2. IC CANS ARE REQUIRED IN INSULATED CEILINGS.
3. ALL 15A OR 20A, 120V BRANCH CIRCUITS IN DWELLING UNITS SUPPLYING OUTLETS OR DEVICES IN KITCHENS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT.
4. ALL 125 VOLTS 15 AND 20 AMPERE RECEPTACLES AS REQUIRED IN NEC 210.52 IN DWELLING UNITS SHALL BE TAMPER-RESISTANCE.
5. ALL SMOKE DETECTORS SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE INDIVIDUAL UNIT. CBC R314.5 .
6. CONDUCTORS OF A MULTI-WIRE BRANCH CIRCUIT SHALL ORIGINATE FROM THE SAME PANELBOARD. THE BRANCH CIRCUIT SHALL BE PROVIDED WITH A MEANS THAT WILL SIMULTANEOUSLY DISCONNECT ALL UNGROUNDED CONDUCTORS AT THE POINT WHERE THE BRANCH CIRCUIT ORIGINATES.
(210.4.240.15(B)(1)).

(CD) ——— CARBON MONOXIDE
 DETECTOR (TYP.)
 (SD) ——— SMOKE DETECTOR
 (TYP.)

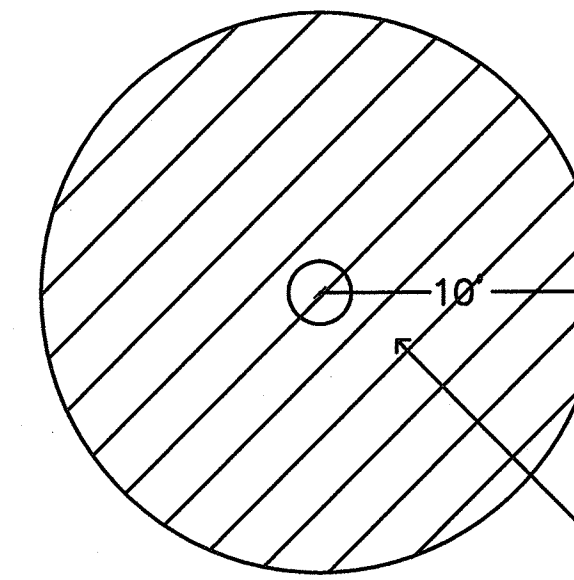

SUMP PUMP HAZARDOUS AREA DETAIL
N.T.S.

(TYP.)

UP

STORAGE 5

A-6

PARKING 5

FOR SUMP PUMP
A-25.27
SEAL
30AS/20AF

MECHANICAL

FOR FSD
A-22

IP

PROVIDE A SWITCH, GFCI RECEPTACLE AND A LIGHT FIXTURE(100W) MOUNT AT ELEVATOR PIT AS DIRECTED BY THE ELEVATOR EQUIPMENT SUPPLIER

ELEV

GFCI

A-1

A-3

A-9

A-7

ELEV

A-5

A-4

200AS
HP-1

1-1/2" C-3#1/0#1#6GND

PROVIDE DISCONNECT SWITCH FUSE WIRE PER ELEVATOR SUPPLIER REQUIREMENTS HP-5

1-1/2" C-3#1/0#1#6GND


STORAGE 6


A-11

100AS
80AF

IP

PL



 <p>PERFECT DESIGN & INVESTMENT, INC. Fire Protection • Fire-Resistant Construction • Fire-Conditioning, Plumbing, Fire Sprinkler System, Electrical, Life 24 Emergency Calculation. 2416 W. Valley Blvd. Alhambra, CA 91803 Tel: (626) 289-4808 Fax: (626) 289-4813 E-Mail: PERFECTD&I@aol.com E-Mail: perfectd&i@gmail.com</p>	REVISIONS BY
--	--------------

38 UNITS OF APARTMENT
1815 - 1821 S BRAND
GLENDALE, CA

Scale

Job # F20-1139

Sheet

E-3

Of Sheets

