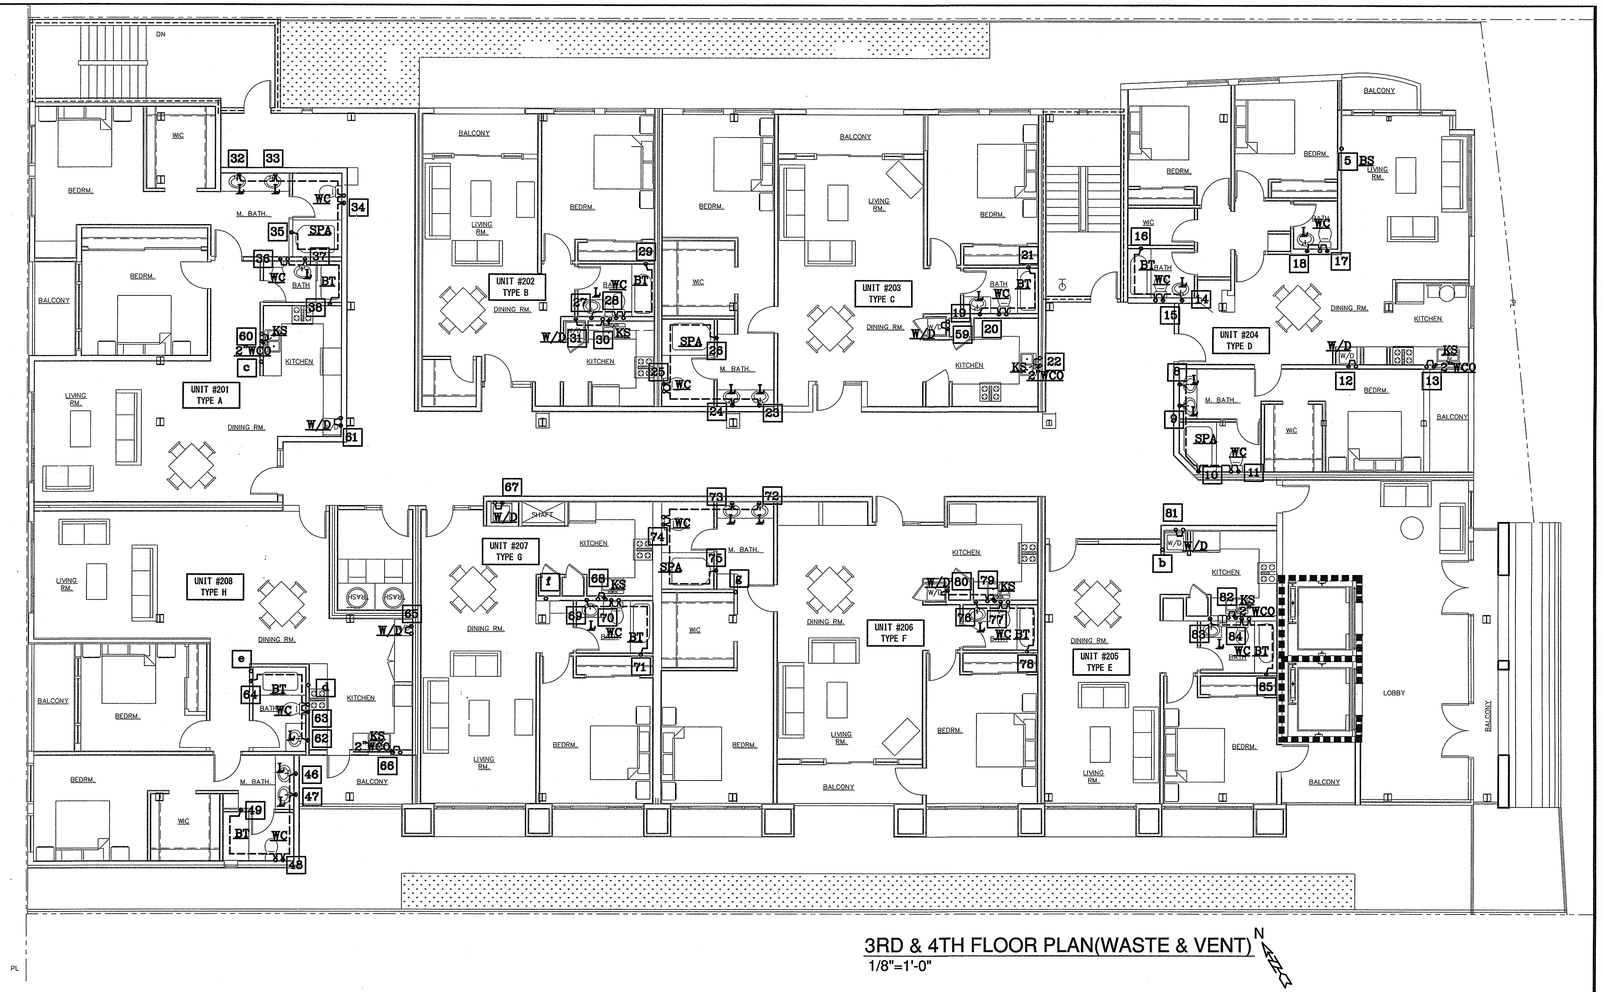

3RD & 4TH FLOOR PLAN(WASTE & VENT)

1/8"=1'-0"

P-10
NOTE: FOR WASTE & VENT PIPING SIZE SEE "WASTE & VENT PIPING RISER DIAGRAM" ON SHEETS P-17, P-18, P-19, P-20, P-21 & P-22.

REGISTERED PROFESSIONAL ENGINEER
RAYMOND MENG ZHANG
No. M-27635
Exp. 06-30-21
MECHANICAL
STATE OF CALIFORNIA

REVISIONS	BY

PERFECT DESIGN & INVESTMENT, INC.
•Design & Consulting
•air-Conditioning, Plumbing, Fire Sprinkler System,
Electrical, Title 24 Energy Calculation.
2416 W. Valley Blvd.
Alhambra, CA 91803
E-Mail:PERFECTIAA@aol.com Tel: (626) 289-6808
E-Mail:perfectiaa@gmail.com Fax: (626) 289-4913

38 UNITS OF APARTMENT

1815 - 1821 S. BRAND
GLENDALE. CA.

Date	08 - 28 - 2020
Scale	
Drawn	E.Y.
Job #	F20-1139
Sheet	**P-10**
Of	Sheets